


SECOND TAXING DISTRICT WATER DEPARTMENT

STANDARD METER PIT CONFIGURATION

SCHMATIC ONLY NOT TO SCALE

FINISHED GRADE MUST BE LEVEL WITH THE PIT COVER TO A MINIMUM OF 4 FEET IN ALL DIRECTIONS FROM THE CENTER OF THE PIT

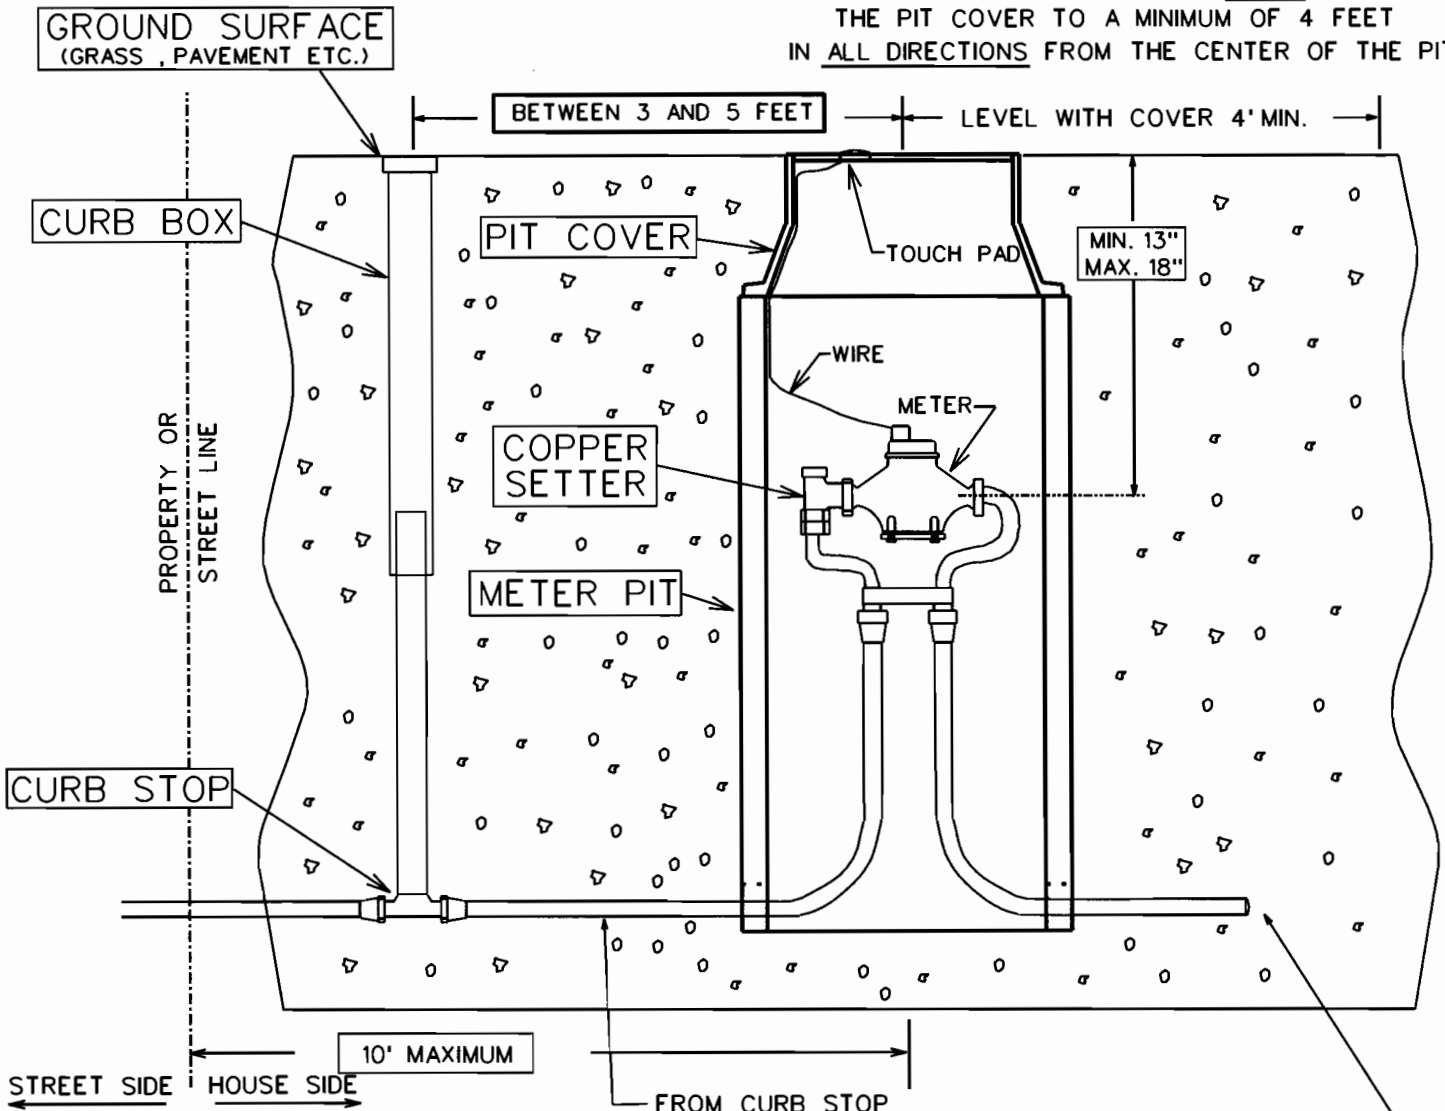

NOTES

THE METER PIT SHALL BE INSTALLED WITHIN TEN FEET (10') OF THE PROPERTY OR STREET LINE

MINIMUM SERVICE PIPE COVER IS 4 FEET

THE WATER DEPARTMENT INSTALLS SERVICES UP TO AND INCLUDING THE CURB BOX AND CURB STOP LEAVING A NPT OR FLARED TYPE CONNECTION ON THE HOUSE SIDE.

THE WATER DEPT. WILL INSTALL A WATER METER WITH A TOUCH PAD WIRED TO THE PIT COVER LID AFTER THE PIT INSTALLATION HAS BEEN INSPECTED AND APPROVED.

FROM CURB STOP
K TYPE COPPER TUBING
MINIMUM ONE INCH

TO HOUSE
K TYPE COPPER TUBING
MINIMUM ONE INCH
EXTENDING SIX FEET FROM PIT

MATERIALS REQUIRED FOR METER PIT SET

- METER PIT *
- METER PIT COVER *
- COPPER SETTER *
- METER W/WIRED TOUCH *
- CURB BOX (if required) *
- CURB STOP (if required) *

* SUPPLIED BY THE WATER DEPT.

* MATERIALS TO BE PURCHASED FROM THE WATER DEPT.